

## 1. Assembling and Installation Method

- 1.1 Mounting method
- 1.2 Isolation from conductive enclosure
- 1.3 Installation to fulfil EMC requirement

## 2. Derating

- 2.1 Derating curve by input voltage
- 2.2 Temperature measuring point

## 3. Wiring

- 3.1 Wiring input connector
- 3.2 Wiring output terminal
- 3.3 Wiring function connector
- 3.4 Jumper factory setting
- 3.5 Output ripple and ripple noise measurement

## 4. Functions

- 4.1 Input voltage range
- 4.2 Inrush current limiting
- 4.3 Over current protection
- 4.4 Over voltage protection
- 4.5 Thermal protection
- 4.6 Output voltage adjustment
- 4.7 Remote ON/OFF
- 4.8 Remote sensing
- 4.9 Adjustable constant current range
- 4.10 Power good (PG)

## 5. Series / Parallel Operation

- 5.1 Series operation
- 5.2 Parallel operation
- 5.3 Redundancy operation

## 6. Life Expectancy and Warranty

- 6.1 Life Expectancy
- 6.2 Warranty

## 7. Option and Others


- 7.1 Option

## 1. Assembling and Installation Method

### 1.1 Mounting method

OFI1200A series should be mounted to a heatsink or enclosure which has sufficient thermal capacity to be cooled by conduction cooling.

OFI1200A has 10 of 4.5mm diameter mounting holes, to keep uniform thermal conductivity, use at least 6 mounting holes as shown in Fig. 1.1. Using all 10 mounting holes is recommended.

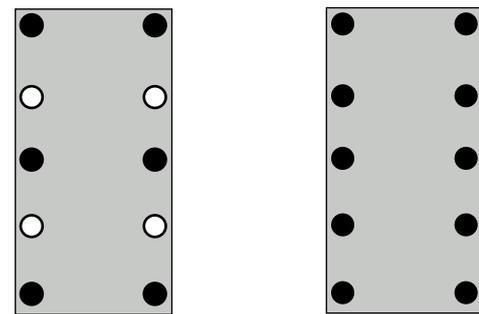

Minimum Recommended  
Fig. 1.1 Mounting hole requirement

A thermal interface material such as thermal pads or thermal grease shall be used to ensure proper cooling of the power supply.

OFI1200A28 and OFI1200A48 without option -O (Active ORing), have open holes in the aluminium baseplate. When using grease as thermal interface material, it could flow to the inside of unit. This is not dangerous, but not desirable. We recommended to not apply grease closer than 10mm from these holes. See Fig. 1.2 for location of open holes.

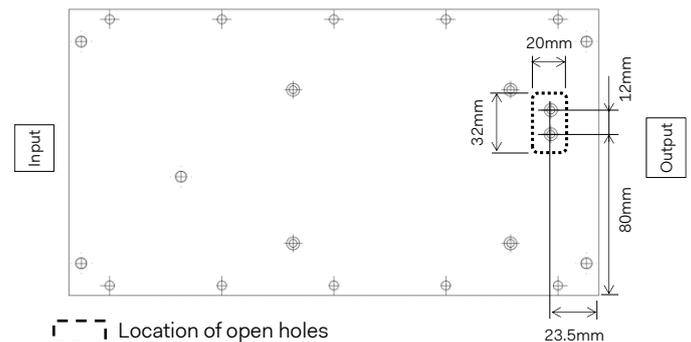


Fig. 1.2 The Location of open hole on aluminium baseplate (Bottom view)

Remarks:

- There is no open holes in aluminium baseplate on units with option -O.

### 1.2 Isolation from conductive enclosure

There are dangerous voltages inside of the unit. Special attention needs to be considered when installing the open type of unit.

Ensure proper isolation distances between the components and conductive enclosure.

$d1, d2 = 4\text{mm min}$

If sufficient isolation distances cannot be secured, an isolation sheet shall be added between a components and external surfaces.

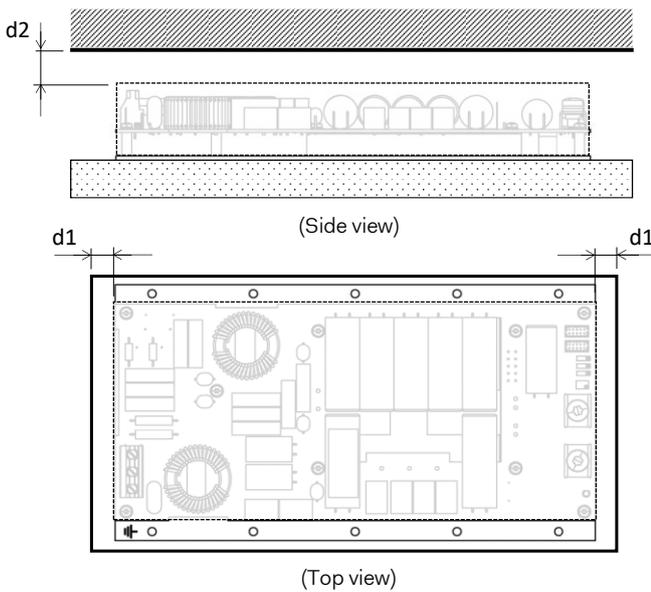


Fig. 1.3 Isolation distance

To optimize cooling airflow around the unit, ensure that the clearance between the unit and surrounding objects is as large as possible.

Remarks:

- In case without option -N (with cover) and the enclosure made by combustible material, the distance  $d2$  shall be more than 13mm because Varistor is implemented inside of the unit. This requirement comes from the safety approvals.

### 1.3 Installation to fulfil EMC requirement

To ensure the best EMI-performance, the equipment should be mounted inside an earthed metal box.

If it is not possible, an install power supply and a load on an earthed metal plate.

Input cables should be twisted and places as close to the metal enclosure as possible.

Output cables of positive (+) and negative (-) should be twisted and shall be separated from input cables as much as possible.

If radiation from input or output cables are an issue, use appropriate EMC ferrite clamp on the cables.

When function pins are connected to a user accessible point (i.e., panel switch, indicator circuit etc.), these must be protected from electrostatic discharging.

## 2. Derating

### 2.1 Derating curve by input voltage

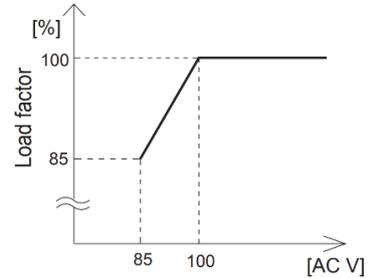


Fig. 2.1 Derating curve by input voltage

Remarks:

- OF1200A12 has no input voltage derating.

### 2.2 Temperature measuring point

For reliable and safe operation, make sure the maximum component temperature rise given in Table 2.1 are not exceeded.

The temperature measuring points are shown in Fig. 2.2.

Operating at the maximum temperature rating results in 3-years life expectancy.

Table 2.1 Maximum operating temperature

Point	Part name	Part Ref.	Maximum Temperature [°C]	
			Standard	Optional: N
A	Baseplate of Internal power supply module	-	See Fig. 2.3	See Fig. 2.3
B	Line filter	L102	110	100
C	Aluminium Electrolytic Capacitor	C405	88	88
D	Aluminium Electrolytic Capacitor	C501	89	89

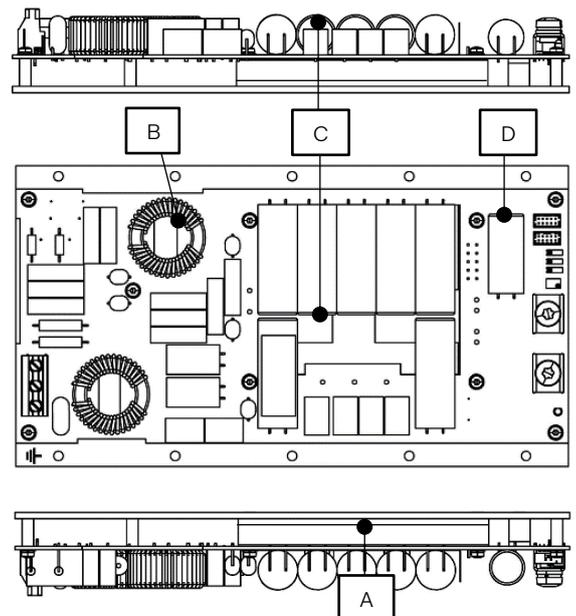


Fig. 2.2 Temperature measuring points

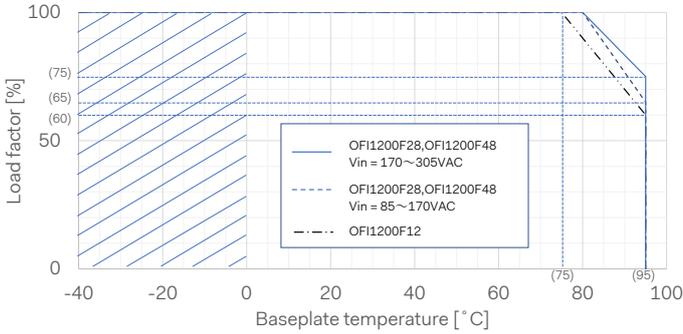


Fig. 2.3 Derating curve of point A (baseplate temperature)

Remarks:  
 Operation in the hatched area may cause significant level of ripple and ripple noise.

<Temperature measurement with cover option>  
 To measure a temperature of internal components in units with option -N (with cover), it is necessary to remove the cover to apply thermocouples on measuring points.

To remove the cover, remove cables from input terminal and remove 4 screws on each corner.  
 There are an isolation sheet and gap pads on the input filter. When the cover is re-installed, make sure that the isolation sheet and gap pads are properly located.

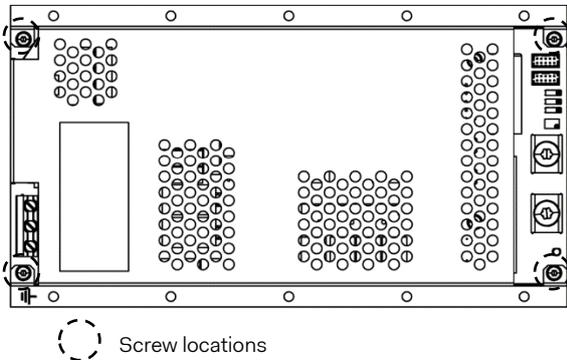


Fig. 2.4 Screws to be removed for temperature measurement

### 3. Wiring

#### 3.1 Wiring input connector

(1) Built-in fuse  
 The two 16 ampere AC fuses are built-in on AC(L) in parallel.

(2) Wire  
 Connection capability of the input connector.

Input connector type	: MKDS 5/ 3-9,5 (1714984) (Phoenix Contact)
Connector cross section solid	: 0.2 mm <sup>2</sup> – 6 mm <sup>2</sup>
Connector cross section flexible	: 0.2 mm <sup>2</sup> – 4 mm <sup>2</sup>
Conductor cross section (AWG)	: AWG 24 – 10
Conductor cross section (flexible, with ferrule)	: 0.25 mm <sup>2</sup> – 4 mm <sup>2</sup>
Stripping length	: 8mm
Torque	: 0.5 – 0.6 Nm

An input current is dependent on input voltage and output current. Choose the appropriate thickness for the input wire.

Influence against noise is improved if the input wires are twisted. In addition, make sure that input and output wires are separated.

#### (3) FG terminal

The FG terminal on input connector shall be Functional Ground. Make sure that the mounting hole for protective earthing on the baseplate is properly connected, as required for class I equipment.

#### 3.2 Wiring output terminal

The assembly torque for output terminal screws.

Screw size	: M6
Recommended screw torque	: 3.8 Nm

At -40°C operation, an external output capacitor needs to be added to ensure stable output voltage during start-up. Table 3.1 shows a recommended an external output capacitor.

Table 3.1 Recommended external output capacitor

Models	Value
OF1200A12	7,800 μF
OF1200A28	3,000 μF
OF1200A48	1,360 μF

#### 3.3 Wiring function connector

Fig. 3.1 shows the pin assignment and Table 3.2 states the pin configuration of function connector X506 and X507.

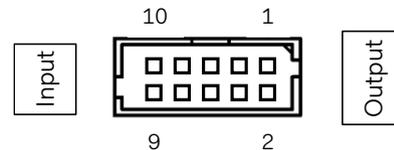


Fig. 3.1 X506 and X507 Pin assignment

Table 3.2 Function of connector X506 and X507

Pin No.	Name	Function
1	CB	Refer to Section 5.2
2	-S	Refer to Section 4.8
3	PG	Refer to Section 4.10
4	RC1	Refer to Section 4.7
5	ITRM	Refer to Section 4.9
6	VTRM	Refer to Section 4.6
7	NC	
8	PGG	Refer to Section 4.10
9	+S	Refer to Section 4.8
10	RC2	Refer to Section 4.7

<Connector information>

Part number : 87831-1041 (Molex)

<Appropriate mating connector and pin>

Part number : 51110-1056 (Molex)

Pin : 50394-8051 (Molex)

For connecting X506 and X507, H-SN-61 (Manufactured by Cosel) is available.

<https://en.cosel.co.jp/product/optionparts/H-SN-61/>

Remarks:

- An incorrect connection of functional connector may cause damage on an internal circuit. Make sure the connection is properly made.

3.4 Jumper factory setting

Jumpers on X503, X504 and X601 are placed as shown in Fig. 3.2 at the factory.

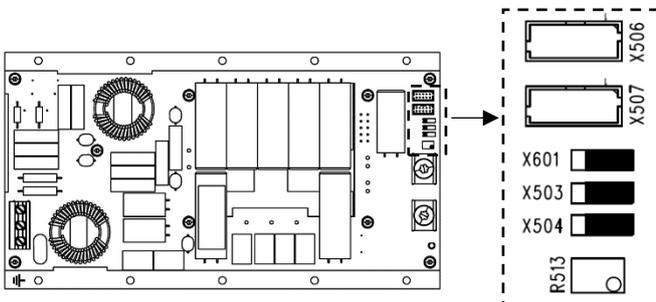


Fig. 3.2 Jumper placement at factory

3.5 Output ripple and ripple noise measurement

The specified ripple and ripple noise are measured by the method shown in Fig.3.3.

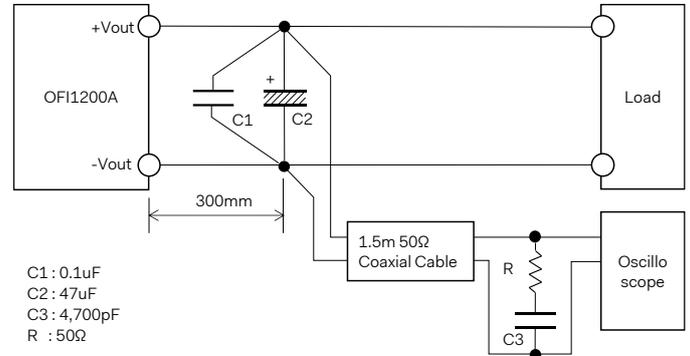


Fig.3.3 Method of Measuring Output ripple and ripple noise

Remarks:

- When the ambient temperature is lower than -20°C, the output ripple may become unstable during heating up.

4. Functions

4.1 Input voltage range

The unit operates with an input voltage range between 85 - 305 Vac. The voltage range for a valid safety approval is 100 - 277 Vac (50/60Hz).

Remarks:

- Be aware that use of voltages other than those listed above may result in the unit not operating according to specifications or may cause damage or dangerous situations. Avoid square waveform input voltage, commonly used in UPS and inverters.

4.2 Inrush current limiting

There is a built-in inrush current limiting circuit.

If you need to use a switch on the input side, select one that can withstand the input inrush current.

The thyristor technique is used in the inrush current limiting circuit. Avoid repeatedly turning the power ON/OFF within a short period of time, operates the inrush current limiting becomes inoperative.

When the input power is turned on, the primary inrush current and secondary inrush current will be generated due to the thyristor technique used for the inrush current limiting circuit.

4.3 Over current protection

The over current protection is built in and comes into effect when drawing over 105% of the rated current.

The over current protection prevents the unit from short circuit and over current condition. The unit automatically recovers when the fault condition is cleared.

When the output voltage drops at over current, the average output current is reduced by hiccup operation of the unit.

#### 4.4 Over voltage protection

The over voltage protection circuit is built in. If the over voltage protection circuit is activated, shut down the input voltage, wait a certain time and turn on the AC input again to recover the output voltage.

The recovery time is 10 seconds or more.

However, it varies depending on such factors as input voltage value at the time of the operation.

Remarks:

- Note that devices inside the power supply might fail if voltage of higher than rated output voltage is applied to output terminal of the power supply. This could happen when the user tests the over voltage performance of the unit.

- With option -O (active Oring) circuit disconnects the output from the external voltage. Therefore, over voltage protection will not activate. Therefore, it is not possible to test over voltage performance for an -O unit by applying external voltage.

#### 4.5 Thermal protection

When the baseplate temperature exceeds the maximum temperature, thermal protection will be activated and shut down the output.

When the thermal protection is activated, turn off the input voltage and eliminate all the overheating conditions. To recover the output voltage, let the unit cool down before turning on the input voltage again.

#### 4.6 Output voltage adjustment

(a) Adjust by potentiometer

To increase output voltage, turn the built-in potentiometer (R513) clockwise. To decrease the output voltage, turn it counter clockwise.

(b) Adjust by external voltage source

To adjust the output voltage by external voltage source, apply it between VTRM and -S terminal.

The output voltage can be calculated by the following equation when the voltage is applied to the VTRM terminal. However, it cannot be set beyond the upper limit of the output voltage adjustment range. The internal circuit of VTRM is shown in Fig. 4.2.

$$\text{Output voltage [V]} = \frac{\text{The voltage between VTRM and -S [V]}}{2.5 \text{ [V]}} \times \text{Rated output voltage [V]}$$

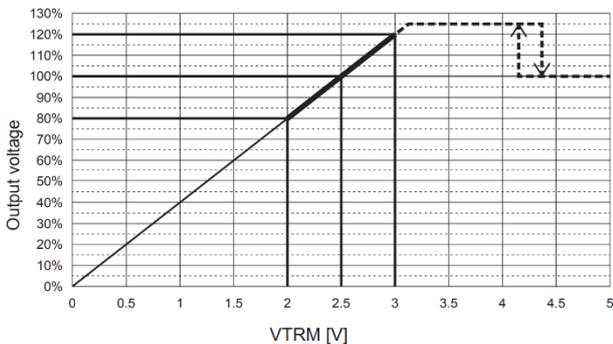


Fig. 4.1 Output Voltage by VTRM

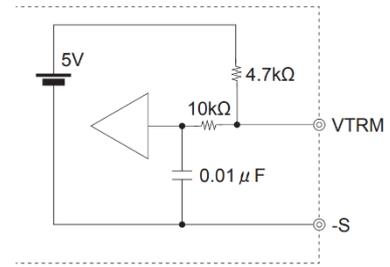


Fig. 4.2 VTRM internal circuit

Remarks:

- To adjust the output voltage by an external voltage source, it must be adjusted the output voltage to within ±20% on the nominal output voltage to avoid damage to R513.

- Do not set the external applied voltage of the terminal to -0.3V or less, and 5.0V or more.

#### 4.7 Remote ON/OFF

Remote ON/OFF is built in. Remote ON/OFF is operated by applying a voltage between RC1 and RC2 pin. The Internal circuit and function of X601 are shown in Fig. 4.3.

When the output shuts off by the over voltage protection or thermal protection, it can be recovered by toggling Remote ON/OFF signal.

The remote control logic can be changed with X601. And the isolation between the RC circuit and any other is dependent on the position of X601's jumper. Those details are shown in Table 4.1 and Fig. 4.4.

Table 4.1 Remote Control Logic

No.	Item	Remote Control Logic		
1	Connection method	Fig. 4.4(a)	Fig. 4.4(b)	Fig. 4.4(c)
2	Isolation	INPUT - RC OUTPUT -	INPUT - RC	INPUT - RC
3	Reference pin	RC2	-S	-S, RC2
4	Output ON	SW OPEN (0.1mA max)		SW SHORT (0.5V max)
5	Output OFF	SW SHORT (2mA min)		SW OPEN (0.1mA max)


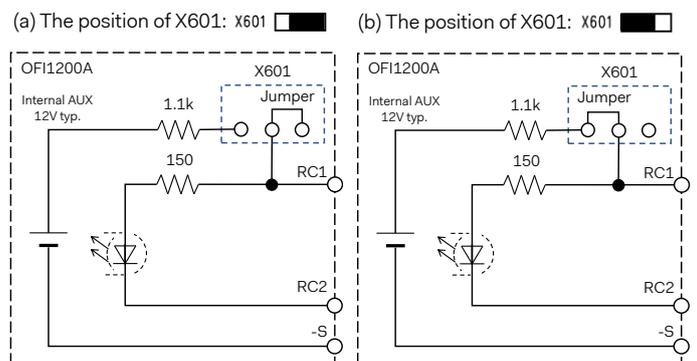


Fig. 4.3 The Internal circuit and function of X601


(a) Use external voltage source (Positive logic)

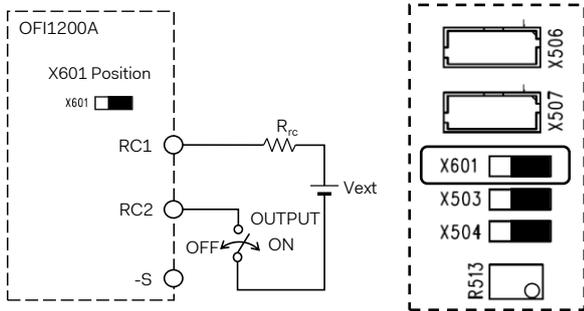

External resistor  $R_{rc}$  value shall be decided by following formula.


$$\frac{V_{ext}[V]-1.4}{2[mA]}-150[\Omega] > R_{rc}[\Omega] > \frac{V_{ext}[V]-0.9}{12[mA]}-150[\Omega]$$

(b) Change position of X601 (Positive logic)

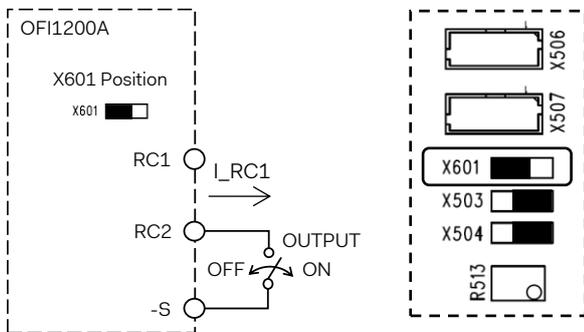

In the case of this connection example, the control current ( $I_{RC1}$ ) flows up to 9.7mA.

(c) Change position of X601 (Negative logic)

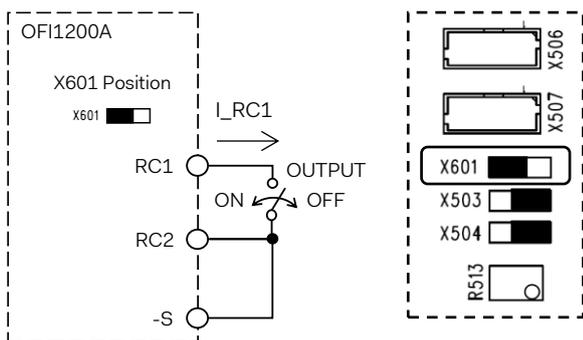

In the case of this connection example, the control current ( $I_{RC1}$ ) flows up to 9.7mA.

Fig. 4.4 Example of connecting remote ON/OFF circuit

Remarks:

- Be careful not to connect RC1 and RC2 opposite. It may cause a failure of unit.


- The sink current of RC1 must be kept up to 12mA.

#### 4.8 Remote sensing

Remote sensing is built in. When remote sensing is not used, make sure that jumpers are placed on X503 and X504 as shown in Fig. 4.5(a).

When using remote sensing function, place jumpers on X503 and X504 as shown in Fig. 4.5(b), then connect +S and -S terminal on X506 or X507 to sensing point.

(a) Disable remote sensing (Factory setting)



(b) Enable remote sensing




Fig. 4.5 X503 and X504 Jumper position

Remarks:

- Twisted-pair wires or shielded wires should be used for sensing wire.

- Use proper cable thickness for the wiring between the unit and load. The line drop between the unit and load should be less than 0.5V. The voltage between +VOUT and -VOUT should remain within the output voltage adjustment range.

- If the sensing lines become short circuited, a high current will occur and the sensing circuit may be damaged. The problem can be prevented by installing current limiting the component near the load.

- As wiring or load impedance may generate oscillation or large fluctuation in output voltage, make sure enough evaluation is given in advance. If the unstable condition occurs, try adding C1 - C3 and R1.

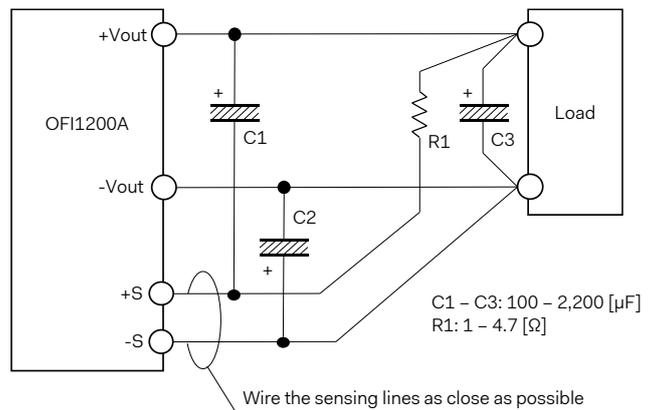


Fig. 4.6 When using remote sensing function

#### 4.9 Adjustable constant current range

The output current for the constant current can be adjusted by connecting external resistors to ITRM or by applying a voltage externally. Meanwhile, the Hiccup mode of the short circuit protection will be disabled.

##### (1) Constant current adjustment by potentiometer

By connecting the external potentiometer as shown in Fig. 4.7, output current for constant current becomes adjustable.

Wiring to the potentiometer should be as short as possible. As the ambient temperature fluctuation characteristics deteriorate depending on the types of resistors and potentiometers, use resistors and a potentiometer of the following specifications:

Potentiometers: Cermet type, coefficient less than  $\pm 300\text{ppm}/^\circ\text{C}$

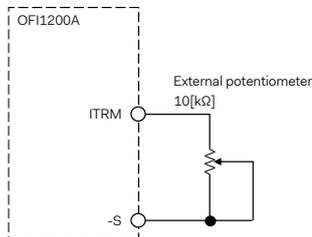


Fig. 4.7 Connection for CC by external potentiometer

##### (2) Constant current adjustment by external voltage

By applying a voltage externally to ITRM, output current for constant current becomes adjustable.

When the ITRM terminal voltage is set at less than 2.5 V, the constant current set value can be changed.

$$\text{Output current [A]} = \frac{\text{The voltage between ITRM and -S [V]}}{2.5 \text{ [V]}} \times \text{Rated output current [A]}$$

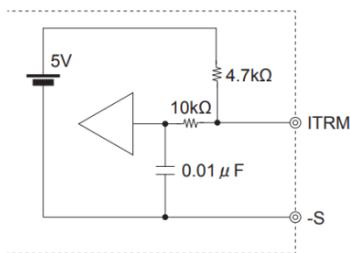


Fig. 4.8 ITRM internal circuit

#### Remarks:

- If the output voltage becomes less than 5% of the rated voltage during constant current operation, the output voltage may become unstable.

- When the output current adjustment is not used, keep ITRM pin open.

- Do not set the external applied voltage to -0.3 V or less, and 5.0 V or more.

#### 4.10 Power good (PG)

By using power good signal (PG), it is possible to monitor the unit whether normal operation or abnormal operation. The PG signal is "Low" when the unit operates correctly. The signal turns to "High" when the unit stops.

The PG circuit is designed as shown in Fig. 4.9. The sink current of PG is 1mA max.

The circuit of the PG (PG, PGG) is isolated from input, output, FG, and various function terminals.

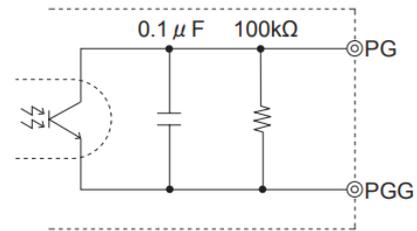


Fig. 4.9 Internal circuit of PG

The details of PG signal are shown in Table 4.3, Fig. 4.10, and Fig. 4.11.

Table 4.3 Specification of PG

No.	Item	PG
1	Function	Normal operation "Low"
		The unit stops "High"
2	Base pin	PGG
3	Level voltage "L"	0.5V max at 1mA
4	Level voltage "H"	Open corrector
5	Maximum sink current	1mA max
6	Maximum applied voltage	50V max

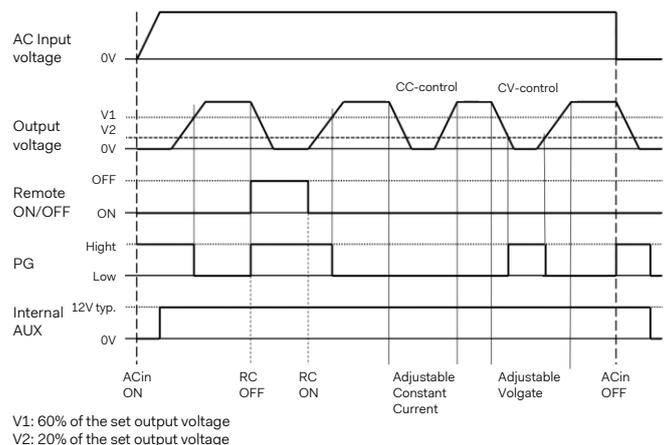


Fig. 4.10 PG signal sequence

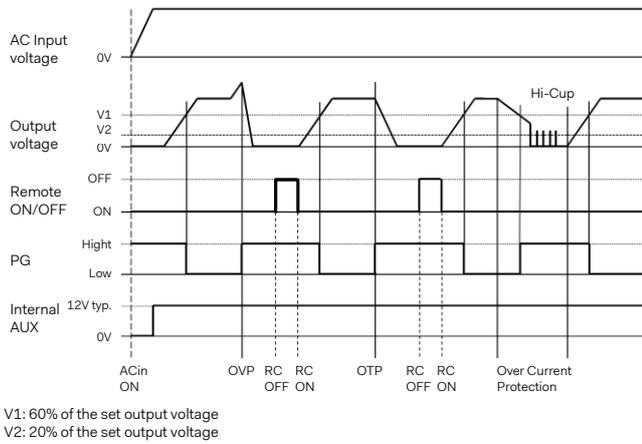


Fig. 4.11 PG signal sequence with circuit protections

## 5. Series / Parallel Operation

### 5.1 Series operation

Series operation is possible by connecting the output of two or more power supplies as shown in Fig. 5.1.

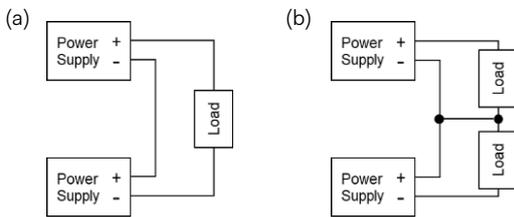


Fig. 5.1 Example of Series operation

Output current in series connection should be lower than the lowest rated current in each unit.

When one of unit's output becomes short circuit in series operation, high voltage may be applied to rest of units. To avoid further damages, consider adding a protection method that immediately stops operation.

Make sure that the combined total output voltage is less than 120Vdc.

The classification of Electrical energy source of output voltage for OF1200A12 and OF1200A28 are ES1, and OF1200A48 is ES2. Therefore, make sure the safety requirement when total output voltage exceeds 60Vdc.

### 5.2 Parallel operation

#### (a) Wiring for parallel operation

Parallel operation is available by connecting the units as shown in Fig. 5.2. With this wiring, it is possible to adjust all output voltages in the unit by the potentiometer (R513) of the master unit. Select one unit as the master and turn the R513 of the other unit (slave) clockwise to the maximum output voltage adjustment following the datasheet.

It is not necessary to connect the VTRM terminals together.

Total current should not exceed the value calculated by the following equation, and total number of units should be no more than 9 pieces.

$$\text{(Output current at parallel operation)} = (\text{the rated current per unit}) \times (\text{number of unit}) \times 0.9$$

Make sure that the wiring impedance of a load from each unit becomes even.

Voltage drop from a unit to the sensing point should be less than 0.5V for stable control.

If the temperatures of aluminium baseplate are different in the unit in parallel operation, the difference of output current becomes large. Consider the thermal design to equalize aluminium baseplate temperatures. (i.e., attaching a single heatsink etc)

To connect the sensing terminal (+S, -S), the cables should connect to the sensing point directly from each unit. If not, the output voltage may become unstable or fluctuated.

If the output current is less than 2% of the rated current, the output voltage ripple will be large.

If all paralleled unit need to start up at the same time, remote control function shall be used.

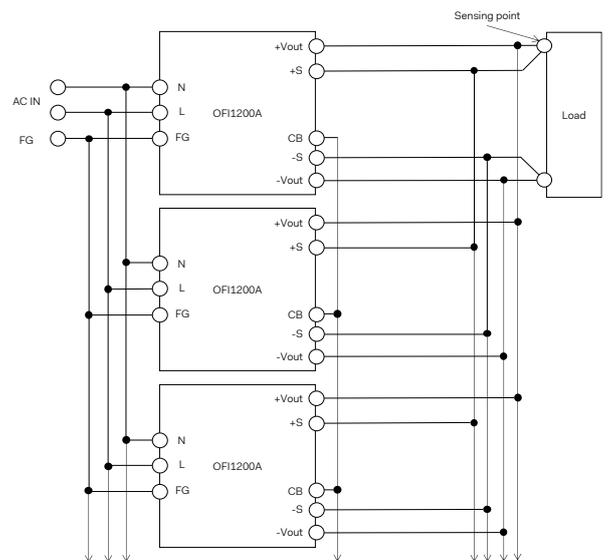


Fig. 5.2 Example of parallel operation

(b) Wiring for parallel operation with remote control  
 Example of connecting remote ON/OFF circuits during parallel operation are shown in Fig. 5.3 and Fig. 5.4. Refer to section 4.7 "Remote ON/OFF" how to use this function.

In this case, accumulated current ( $N \times I_{RC1}$ ) flows to the control switch.

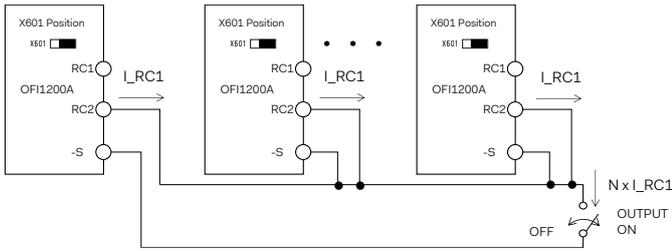


Fig. 5.3 Example of connecting remote ON/OFF circuit

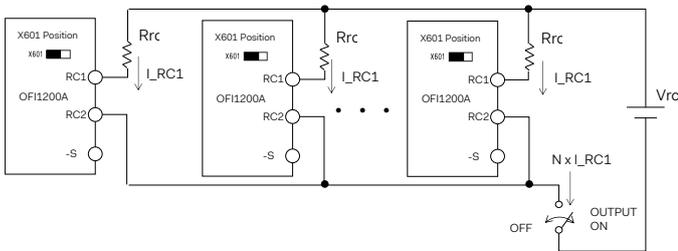


Fig. 5.4 Example of connecting remote ON/OFF circuit

(c) Wiring for parallel operation with constant current adjustment  
 The constant current adjustment can be used even in parallel operation. By changing the ITRM voltage of one unit, the constant current adjustable for all of units. It is not necessary to connect the ITRM terminals together. Examples of connecting constant current circuit during parallel operation are shown in Fig. 5.5 and Fig. 5.6.

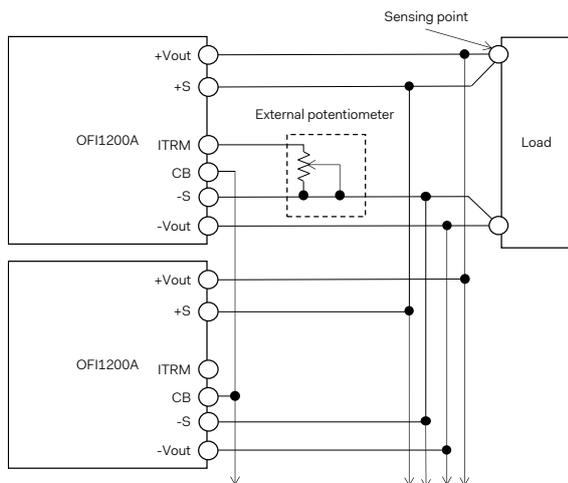


Fig. 5.5 Example of connecting constant current circuit with potentiometer

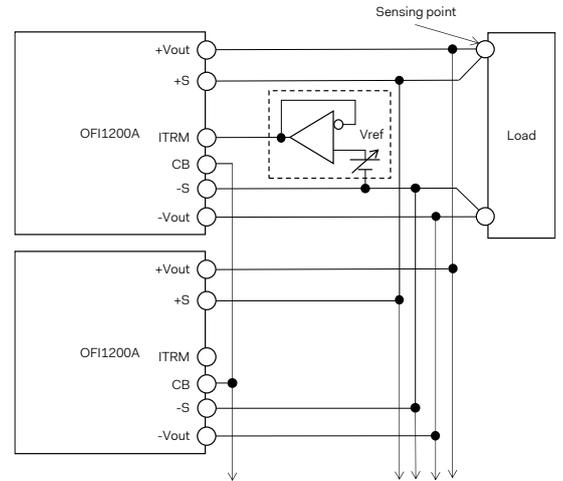


Fig. 5.6 Example of connecting constant current circuit with external voltage

### 5.3 Redundancy operation

1 + 1 redundancy operation is possible by wiring as shown in Fig. 5.7.

By choosing option -O, ORING MOSFET is implemented into the unit. Therefore, it is possible to connect each output directly for 1+1 redundancy operation.

When using without option -O, add diodes on +Vout of each unit.

Even a slight difference in output voltage can affect the balance between the values of  $I_1$  and  $I_2$ .

Make sure that the maximum value of  $I_3$  does not exceed the rated current of a single unit.

$$I_3 \leq \text{the rated current value}$$

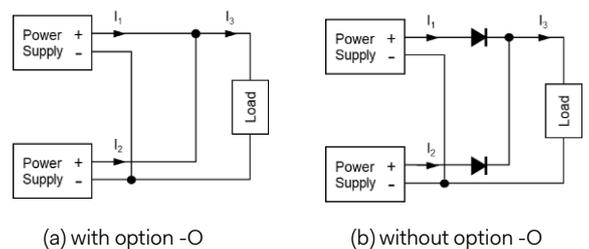


Fig. 5.7 Examples of 1+1 Redundancy operation

## 6. Life Expectancy and Warranty

### 6.1 Life Expectancy

A life expectancy is strongly dependent to operating temperature and cooling conditions.

To make sure the life expectancy, measure temperature of Electrolytic capacitors shown in Fig. 6.1 and calculate by following formula.

$$L=L_{105} \times 2^{\frac{105-T_{cap}}{10}}$$

where

L : Life expectancy [hour]

L<sub>105</sub> : Endurance at 105°C [hour], see table 6.1

T<sub>cap</sub> : Temperature of Electrolytic capacitor[°C]

Table 6.1 Endurance of Electrolytic capacitor

Item		C406	C501
L <sub>105</sub>	Endurance at 105[°C]	12,000h	8,000h

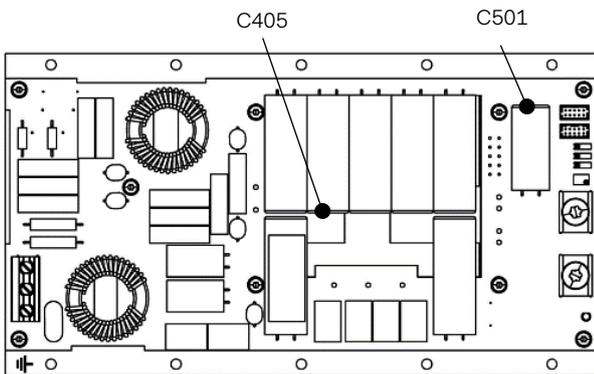


Fig. 6.1 Temperature measuring point for Life expectancy

### 6.2 Warranty

Warranty term is 3 years.

## 7. Option and Others

### 7.1 Options

(1) Option -N: with Metal cover

The metal cover option improves radiated noise from the unit and gives better mechanical protection.

(2) Option -O: with Active Oring

ORing MOSFET is added. It enables to connect each output of same model to use as redundancy operation without additional components.